

Certificate of Conformance

to

EN15182-2 (2010) Handheld Branchpipes for Fire Service Use

Task Force Tips, LLC certifies that the following nozzles meet or exceed the requirements found in the EN15182-2 (2010) standard.

Ultimatic FO6 PN16

with 30 to 60° narrow spray jet detent zone



*For supporting documentation
contact us at www.tft.com*

TASK FORCE TIPS

Delivers what our customers need, when they need it.



**TASK FORCE TIPS, INC
REGISTERED TO ISO 9001:2008
FILE NUMBER 10001004 QM08**

Annex C
(normative)

Datasheet for hand-held branchpipes for fire service use

C.1 General


- NOTE 1** The symbol * means “where applicable” in the whole datasheet
NOTE 2 Actual test results can be entered in the data sheet when these results exceed the minimum requirements given in this Standard

C.2 General data


1.1 Manufacturer	Task Force Tips, Inc. – Valparaiso, IN - USA
1.2 Type	Ultimatic FO6 PN16; 30-60° narrow spray jet detent zone
1.3 Type according to EN 15182-1 Annex A	Type 4.1
1.4 Flowrate (l/min) at p_R	400 l/min @ 6 bar
1.5 Flow settings *	0 – 400 l/min
1.6 Type of spray *	Full Cone


C.3 Flow pressure chart

Use the following symbols to represent different types of cone spray:

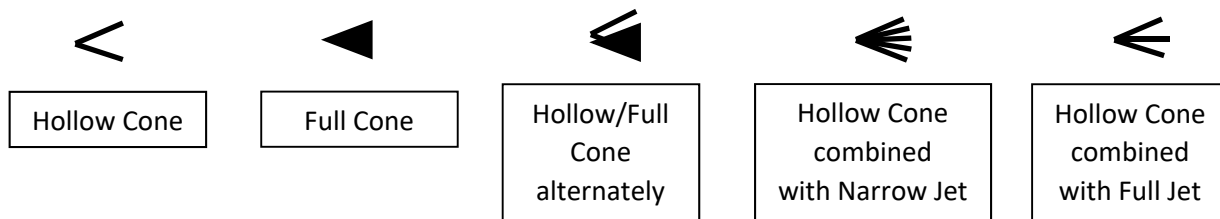

Use the following symbols to represent flow at spray types (NN represents throw in METERS):

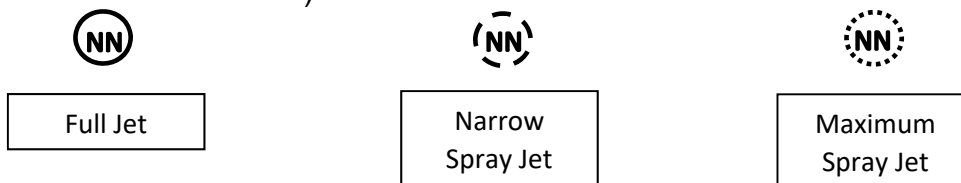

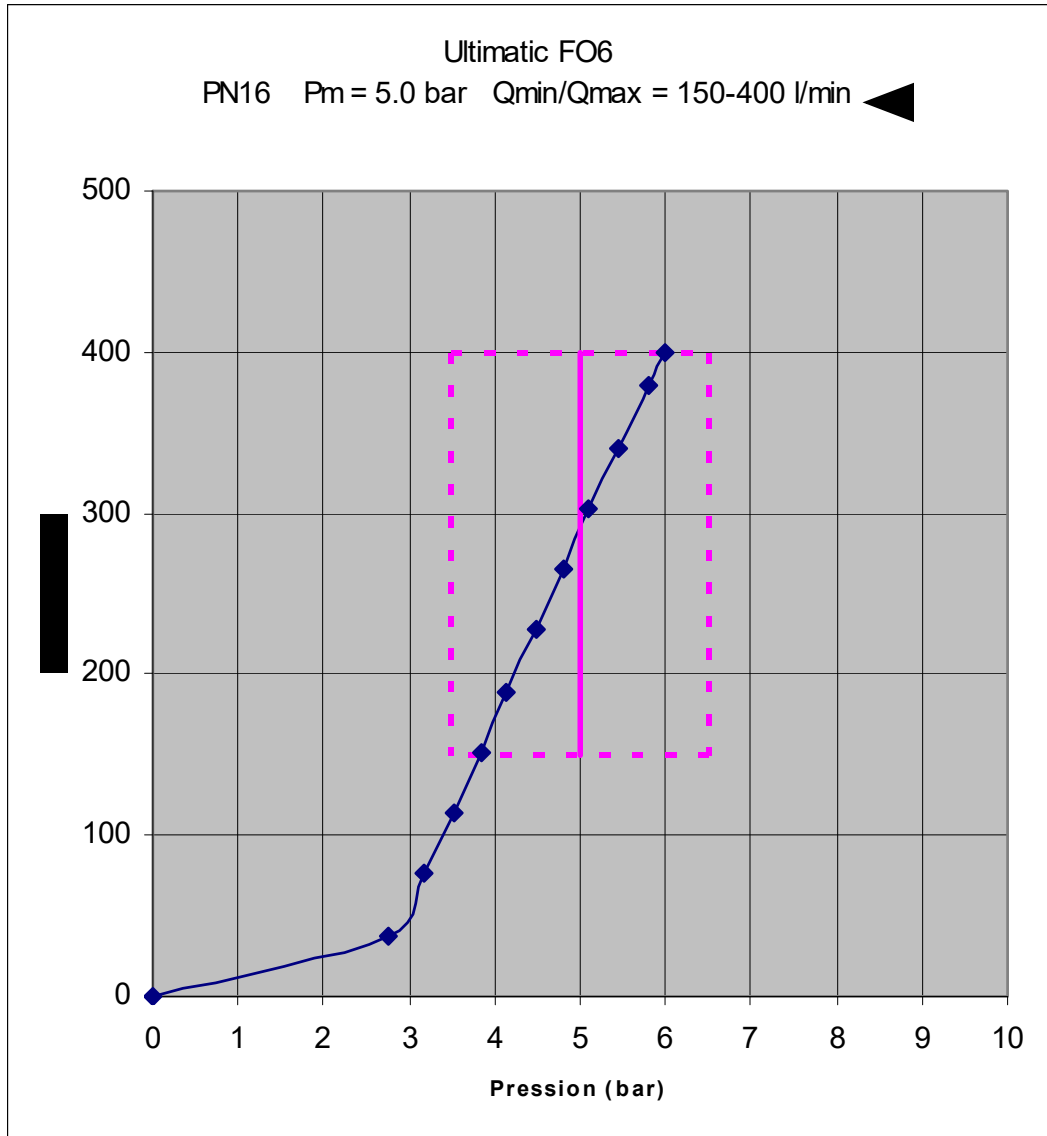

150 l/min

23

13.6

3

400 l/min

36

11

4

C.4 Operational devices

3.1 Fitting system	Swiveling Coupling
3.2 Gripping device	Pistol Grip
3.3 Open/shut-off device *	Slide Valve
3.4 Jet/spray system *	Rotating operating element
3.5 Flow adjustment system *	Slide Valve

C.5 Requirements

OPERATING AND HANDLING	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN 15182-2/4.2.1	Dimensions (mm)	≤ 450x300x150	270x120x239
	EN 15182-2/4.2.1	Mass (kg)	≤ 3.5	1.4
	EN 15182-2/4.2.2	Torques needed for moving operating elements (N·m)		
		Valve Handle (Bale)	≤ 15	3.36
		Open Valve with Trigger	≤ 15	2.60
		Engage Trigger Lock	≤ 15	.113
		Disengage Trigger Lock	≤ 15	1.56
		Flow adjustment element	≤ 15	3.36
		Jet adjustment element	≤ 10	0.5
EN 15182-2/4.2.3	Flow adjustment *			
	Rotation from minimal to maximal flow	≤ 180°	N/A	
EN 15182-2/4.2.4	Jet adjustment *			
	Rotation from straight jet to wide spray jet with a minimal spray angle of 100°	70° - 180°	138°	

PERFORMANCE	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN 15182-2/4.3.3	Effective throw (m)	32.5	36
		Spray jet *		
	EN 15182-2/4.3.4	Wide spray jet *: angle	≥ 100°	113°
	EN 15182-2/4.3.5	Narrow spray jet *: angle	≥ 30°	30°-60°

PHYSICS	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN 15182-1/7.2.2	Sensitivity to frost (° C)	Operational after 30 min @ (-15±2)°C	PASS
	EN 15182-1/7.2.1	Sensitivity to heat (° C)	Operational after 24 h @ (55±2)°C	PASS
	EN 15182-1/6.3.1	Non-obstruction test (mm)	4.76	PASS
	EN 15182-2/4.3.1	Burst pressure (bar)	≥ 60 bar	PASS

C.6 Operational extra data (no requirements)

Relevant sub clause number per standard	Item	Test Result
Ageing tests		
	UV test	
	Ozone test	
	Corrosion test	HARDCOAT EXCEED MILITARY SPECIFICATION MIL-A-8625F

C.7 Data certified by *:

Adam Ritchey
Quality Manager
Task Force Tips