

# *Certificate of Conformance*

*to*

*EN15182-2 (2010) Handheld Branchpipes for Fire Service Use*

*Task Force Tips, Inc. certifies that the following nozzles meet or exceed the requirements found in the EN15182-2 (2010) standard.*

## **Ultimatic FO6 PN16**

*For supporting documentation contact us at [www.tft.com](http://www.tft.com)*



***TASK FORCE TIPS***

*Delivers what our customers need, when they need it.*



TASK FORCE TIPS, INC  
REGISTERED TO ISO 9001:2008  
FILE NUMBER 10001004 QM08

**Annex C**  
(normative)

**Datasheet for hand-held branchpipes for fire service use**

**C.1 General**

- NOTE 1** The symbol \* means “where applicable” in the whole datasheet  
**NOTE 2** Actual test results can be entered in the data sheet when these results exceed the minimum requirements given in this Standard

**C.2 General data**

1.1 Manufacturer	<b>Task Force Tips, Inc. – Valparaiso, IN - USA</b>
1.2 Type	<b>Ultimatic FO6 PN16</b>
1.3 Type according to EN 15182-1 Annex A	<b>Type 4.1</b>
1.4 Flowrate (l/min) at $p_R$	<b>400 l/min @ 6 bar</b>
1.5 Flow settings *	<b>0 – 400 l/min</b>
1.6 Type of spray *	<b>Full Cone</b>

**C.3 Flow pressure chart**


Use the following symbols to represent different types of cone spray:



Hollow Cone	Full Cone	Hollow/Full Cone alternately	Hollow Cone combined with Narrow Jet	Hollow Cone combined with Full Jet
-------------	-----------	------------------------------	--------------------------------------	------------------------------------

Use the following symbols to represent flow at spray types (NN represents throw in METERS):

Full Jet	Narrow Spray Jet	Maximum Spray Jet

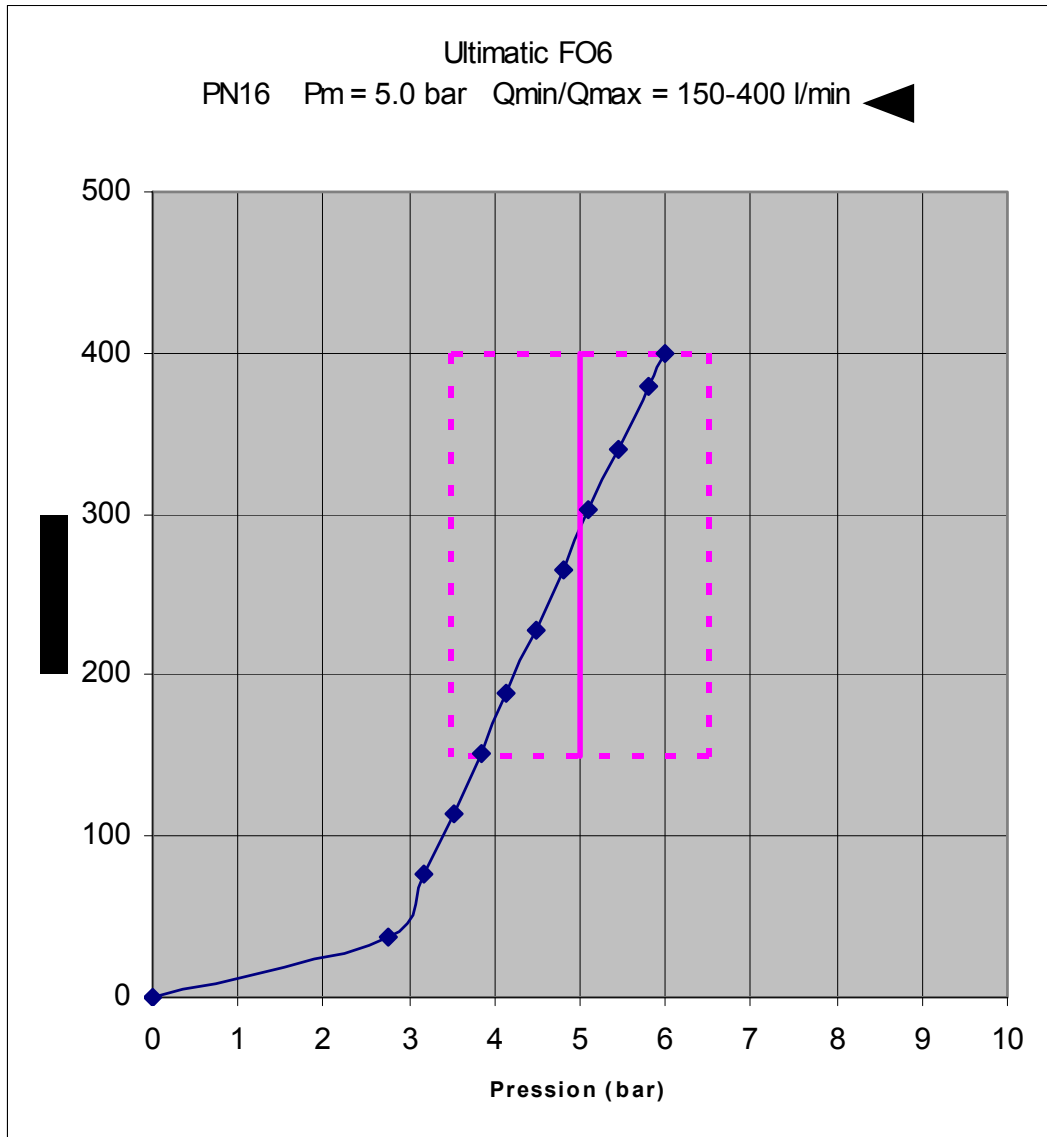

**150 l/min**

23

13.6

3

**400 l/min**

36

11

4

#### C.4 Operational devices

3.1 Fitting system	Swiveling Coupling
3.2 Gripping device	Pistol Grip
3.3 Open/shut-off device *	Slide Valve
3.4 Jet/spray system *	Rotating operating element
3.5 Flow adjustment system *	Slide Valve

#### C.5 Requirements

OPERATING AND HANDLING	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN 15182-2/4.2.1	<b>Dimensions (mm)</b>	≤ 450x300x150	270x120x239
	EN 15182-2/4.2.1	<b>Mass (kg)</b>	≤ 3.5	1.4
	EN 15182-2/4.2.2	<b>Torques</b> needed for moving operating elements (N·m)		
		Lever *	≤ 15	N/A
		Valve Handle *	≤ 15	3.36
		Flow adjustment element	≤ 15	3.36
		Jet adjustment element	≤ 10	0.5
	EN 15182-2/4.2.3	Rotating inlet element	≤ 5	0.9
		<b>Flow adjustment *</b>		
EN 15182-2/4.2.4	Rotation from minimal to maximal flow	≤ 180°	N/A	
	<b>Jet adjustment *</b>			
	Rotation from straight jet to wide spray jet with a minimal spray angle of 100°	70° - 180°	138°	

PERFORMANCE	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN 15182-2/4.3.3	Effective throw (m)	32.5	36
		<b>Spray jet *</b>		
	EN 15182-2/4.3.4	Wide spray jet *: angle	$\geq 100^\circ$	113°
EN 15182-2/4.3.5	Narrow spray jet *: angle	$\geq 30^\circ$	60° (Armada versions 30°-50°)	

PHYSICS	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN 15182-1/7.2.2	<b>Sensitivity to frost (° C)</b>	Operational after 30 min @ (-15±2)°C	PASS
	EN 15182-1/7.2.1	<b>Sensitivity to heat (° C)</b>	Operational after 24 h @ (55±2)°C	PASS
	EN 15182-1/6.3.1	<b>Non-obstruction test (mm)</b>	4.76	PASS
	EN 15182-2/4.3.1	<b>Burst pressure (bar)</b>	$\geq 60$ bar	PASS

### C.6 Operational extra data (no requirements)

Relevant sub clause number per standard	Item	Test Result
<b>Ageing tests</b>		
	UV test	
	Ozone test	
	Corrosion test	HARDCOAT EXCEED MILITARY SPECIFICATION MIL-A-8625F

**C.7 Data certified by \*:**

**Adam Ritchey  
Quality Manager  
Task Force Tips**