

# *Certificate of Conformance*

*to*

*EN15182-4 (2019) Handheld Branchpipes for Fire Service Use*

*Task Force Tips, LLC certifies that the following nozzles meet or exceed the requirements found in the EN15182-4 (2019) standard.*

**25 mm G-Force PN 40 model numbers<sup>†</sup>:**

GDP*2M**H	GDP*3M**H	GDP*5M**H	GDP*6M**H	GDP*7M**H
-----------	-----------	-----------	-----------	-----------

<sup>†</sup>see CERT0096 for EN15182-2 (2019) PN 16 model numbers



*For supporting documentation  
contact us at [tfti.com](http://tfti.com)*

***TASK FORCE TIPS***

*Delivers what our customers need, when they need it.*



TASK FORCE TIPS LLC  
REGISTERED TO ISO 9001:2015  
FILE NUMBER 10001004 QM15

**Annex C (normative)**

**Datasheet for hand-held branchpipes for fire service use**

**C.1 General**


**NOTE 1** The symbol \* means “where applicable” in the whole datasheet

**NOTE 2** Actual test results can be entered in the data sheet when these results exceed the minimum requirements given in this Standard

**C.2 General data**

<b>1.1</b> Manufacturer	<b>Task Force Tips, LLC., Valparaiso, IN</b>		
<b>1.2</b> Type	<b>25 mm G-Force PN 40 models below:</b>		
	<b>GDP*2M**H</b>	<b>GDP*3M**H</b>	<b>GDP*5M**H</b>
	<b>GDP*6M**H</b>		<b>GDP*7M**H</b>
<b>1.3</b> Type according to EN 15182-1 Annex A	<b>Type 4.1</b>		
<b>1.4</b> Flowrate (l/min) at $p_R$	<b>60-150 l/min @ <math>P_R</math> 6 bar</b>		
<b>1.5</b> Flow settings *	<b>Auto 150</b>		
<b>1.6</b> Type of spray *	<b>Full cone</b>		

**C.3 Flow pressure chart**

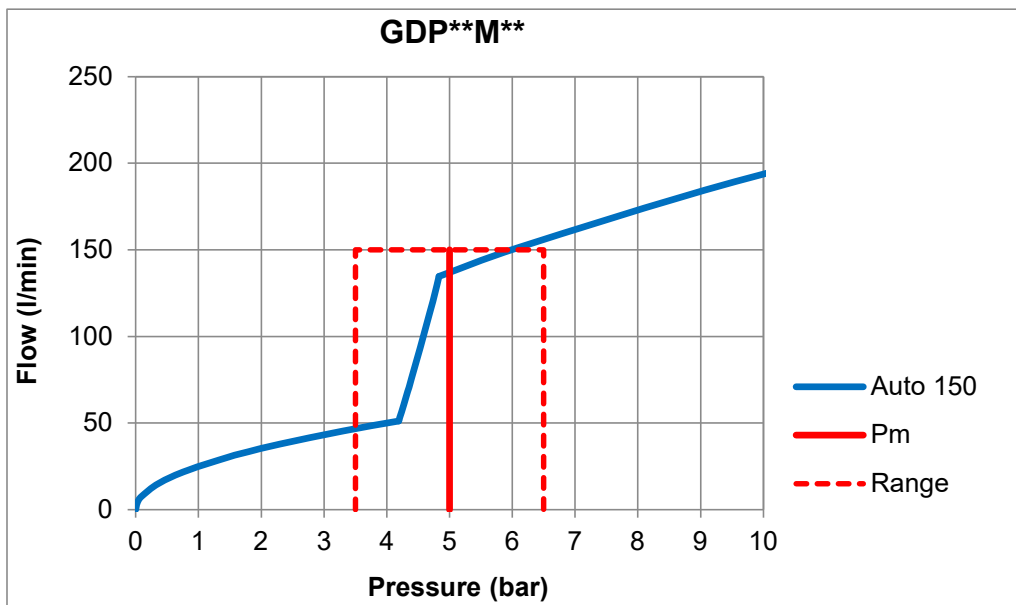

(l/min)	Reach (meters)		
	Straight	Narrow	Wide
150	24	10	4

**C.4 Operational devices**

<b>3.1 Fitting system</b>	Full time swivel
<b>3.2 Gripping device</b>	Pistol grip
<b>3.3 Open/shut-off device *</b>	Slide Valve
<b>3.4 Jet/spray system *</b>	Rotating
<b>3.5 Flow adjustment system *</b>	Rotating

**C.5 Requirements**

OPERATING AND HANDLING	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN15182-4/4.2.1	<b>Dimensions (mm)</b>	≤ 550x350x150	244x226x120
		<b>Mass (kg)</b>	≤ 3.5	1.4
	EN15182-4/4.2.2	<b>Torques</b> needed for moving operating elements (N·m)		
		Valve Handle (Bale)*	≤ 15	9.9
		Open Valve with Trigger*	≤ 15	5.4
		Engage Trigger Lock*	≤ 15	0.1
		Disengage Trigger Lock*	≤ 15	5.0
		Flow adjustment element	≤ 10	4.4
		Jet adjustment element	≤ 10	1.7
EN15182-4/4.2.3	<b>Flow adjustment *</b>			
	Rotation from minimal to maximal flow	≤ 180°	156°	
EN15182-4/4.2.4	<b>Jet adjustment *</b>			
	Rotation from straight jet to wide spray jet with a minimal spray angle of 100°	70° - 180°	127°	

PERFORMANCE	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN15182-4/4.3.3	<b>Effective throw (m)</b>	22	24
	<b>Spray jet *</b>			
	EN15182-4/4.2.4	Wide spray jet *: angle	≥ 100°	PASS
	EN15182-4/4.2.4	Narrow spray jet *: angle	≤ 30°	PASS

	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
<b>PHYSICS</b>	EN15182-1/6.5.3	<b>Sensitivity to frost (° C)</b>	Operational after 30 min @ (-15±2)°C	PASS
	EN15182-1/6.5.2	<b>Sensitivity to heat (° C)</b>	Operational after 24 h @ (55±2)°C	PASS
	EN15182-1/6.4	<b>Non-obstruction test (mm)</b>	4,76	PASS
	EN15182-4/4.5	<b>Burst pressure (bar)</b>	≥ 100 bar	PASS

**C.6 Operational extra data (no requirements)**

Relevant sub clause number per standard	Item	Test Result
<b>Ageing tests</b>		
	UV test	
	Ozone test	
	Corrosion test	HARDCOAT EXCEED MILITARY SPECIFICATION MILA-8625F

**C.7 Data certified by \*:**

**Alan J. Painter**  
**Compliance Manager**  
**Task Force Tips LLC**