

# *Certificate of Conformance*

*to*

*EN15182-2 (2019) Handheld Branchpipes for Fire Service Use*

*Task Force Tips, LLC certifies that the following nozzles meet or exceed the requirements found in the EN15182-2 (2019) standard.*

**38 mm G-Force (GP\*\*Y\*\*) PN 16**



*For supporting documentation  
contact us at [www.tft.com](http://www.tft.com)*

***TASK FORCE TIPS***

*Delivers what our customers need, when they need it.*



TASK FORCE TIPS LLC  
REGISTERED TO ISO 9001:2015  
FILE NUMBER 10001004 QM15

**Annex C**  
(normative)

**Datasheet for hand-held branchpipes for fire service use**

**C.1 General**


**NOTE 1** The symbol \* means “where applicable” in the whole datasheet

**NOTE 2** Actual test results can be entered in the data sheet when these results exceed the minimum requirements given in this Standard

**C.2 General data**

<b>1.1</b> Manufacturer	<b>Task Force Tips, LLC, Valparaiso, IN</b>
<b>1.2</b> Type	<b>38 mm G-Force (GP**Y**) PN 16</b>
<b>1.3</b> Type according to EN 15182-1 Annex A	<b>3</b>
<b>1.4</b> Flowrate (l/min) at $p_R$	<b>500 l/min @ 6 bar</b>
<b>1.5</b> Flow settings *	<b>100, 200, 300, 400, 500</b>
<b>1.6</b> Type of spray *	<b>Full cone</b>

**C.3 Flow pressure chart**

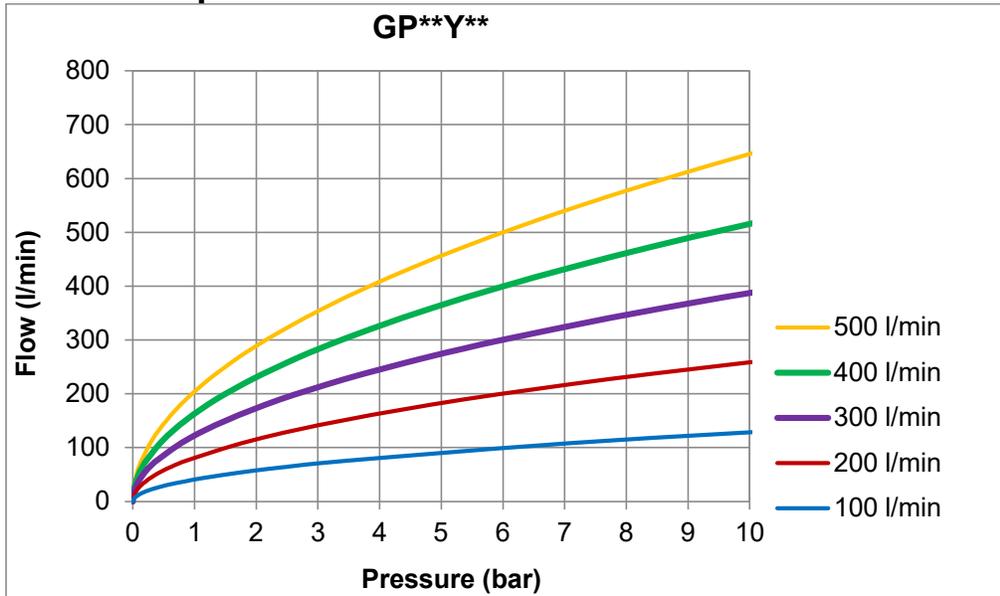

(l/min)	Reach (meters)		
	Straight	Narrow	Wide
100	19	8	3
200	28	11	5
300	35	14	7
400	40	16	8
500	41	17	9

## C.4 Operational devices

3.1 Fitting system	Full time swivel
3.2 Gripping device	Pistol grip
3.3 Open/shut-off device *	Slide Valve
3.4 Jet/spray system *	Rotating
3.5 Flow adjustment system *	Rotating

## C.5 Requirements

OPERATING AND HANDLING	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result	
	EN15182-2/4.2.1	<b>Dimensions (mm)</b>	≤ 450x300x150	254X248X120	
		<b>Mass (kg)</b>	≤ 3,5	2.0	
	<b>Torques</b> needed for moving operating elements (N·m)				
	EN15182-2/4.2.2	Valve Handle (Bail)*	≤ 15	4.1	
		Open Valve with Trigger*	≤ 15	5.4	
		Engage Trigger Lock*	≤ 15	0.1	
		Disengage Trigger Lock*	≤ 15	5.0	
		Flow adjustment element	≤ 10	5.6	
		Jet adjustment element	≤ 10	1.0	
Rotating inlet element		≤ 5	1.5		
<b>Flow adjustment *</b>					
EN15182-2/4.2.3	Rotation from minimal to maximal flow	≤ 180°	156°		
<b>Jet adjustment *</b>					
EN15182-2/4.2.4	Rotation from straight jet to wide spray jet with a minimal spray angle of 100°	70° - 180°	160°		

PERFORMANCE	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result	
	EN15182-2/4.3.3	<b>Effective throw (m)</b>	27	41	
	<b>Spray jet *</b>				
	EN15182-2/4.3.4	Wide spray jet *: angle	≥ 100°	PASS	
	EN15182-2/4.3.5	Narrow spray jet *: angle	≤ 30°	PASS	

PHYSICS	Relevant sub clause number per standard	Item	Minimum Requirement	Test Result
	EN15182-1/6.5.3	<b>Sensitivity to frost (°C)</b>	Operational after 30 min @ (-15±2)°C	PASS
	EN15182-1/6.5.2	<b>Sensitivity to heat (°C)</b>	Operational after 24 h @ (55±2)°C	PASS
	EN15182-1/6.4	<b>Non-obstruction test (mm)</b>	4,76	PASS
	EN15182-2/4.5	<b>Burst pressure (bar)</b>	≥ 60 bar	PASS

**C.6 Operational extra data (no requirements)**

Relevant sub clause number per standard	Item	Test Result
<b>Ageing tests</b>		
	UV test	
	Ozone test	
	Corrosion test	HARDCOAT EXCEEDS MILITARY SPECIFICATION MILA-8625F

**C.7 Data certified by \*:**

**Alan J. Painter**  
**Compliance Manager**  
**Task Force Tips LLC**