

Foam Aspirators


INSTRUCTION FOR INSTALLATION, OPERATION, AND MAINTENANCE

⚠ WARNING


Understand manual before use. Operation of this device without understanding the manual and receiving proper training is a misuse of this equipment. Obtain safety information at tft.com/serial-number.

This equipment is intended for use by trained and qualified emergency services personnel for firefighting. All personnel using this equipment shall have completed a course of education approved by the Authority Having Jurisdiction (AHJ).


This instruction manual is intended to familiarize firefighters and maintenance personnel with the operation, servicing, and safety procedures associated with this product. This manual should be kept available to all operating and maintenance personnel.




MX-FoamJet

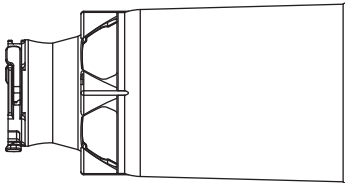


MX-FoamJet

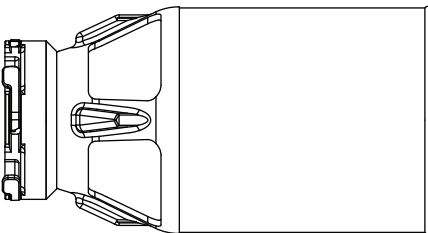


MX-FoamJet

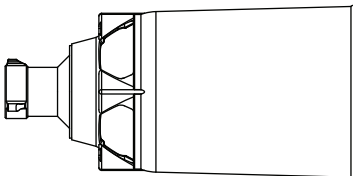


MX Foam Nozzle




FoamJet

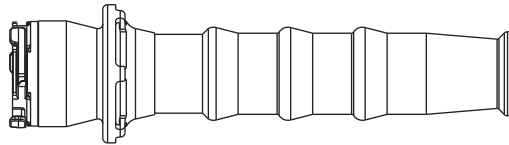


FoamJet-LX

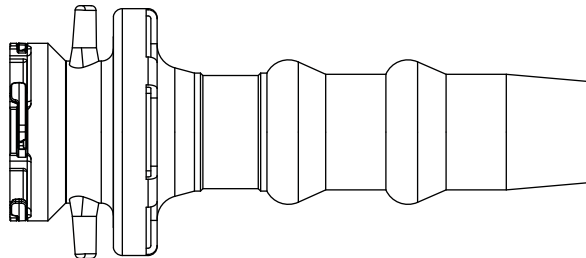

FJ-LX-M

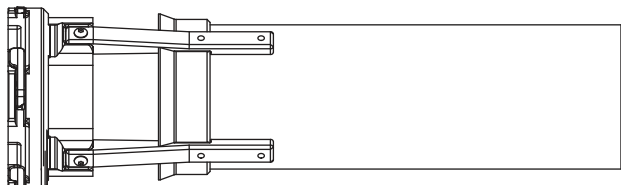

FJ-LX-M2

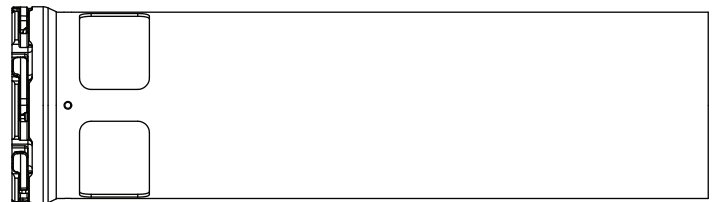

FJ-LX-M3

TABLE OF CONTENTS

- 1.0 MEANING OF SAFETY SIGNAL WORDS
- 2.0 SAFETY
- 3.0 GENERAL INFORMATION
- 4.0 FOAM TYPE, CONCENTRATION, AND PROPORTIONING
- 5.0 ATTACHMENT TO THE NOZZLE
- 6.0 USE OF FOAM ATTACHMENTS
 - 6.1 LX FOAMJET
 - 6.2 MX FOAMJET
- 7.0 USING FOAM
- 8.0 WARRANTY
- 9.0 MAINTENANCE
 - 9.1 FIELD LUBRICATION
 - 9.2 SERVICE TESTING
 - 9.3 REPAIR
- 10.0 OPERATION AND INSPECTION CHECKLIST

A poster with a black and red geometric background. The word "DANGER" is in large red letters at the top. Below it, "PERSONAL RESPONSIBILITY CODE" is in white. The text explains that FEMSA member companies want responders to know and understand the following: 1. Firefighting and Emergency Response are inherently dangerous activities requiring proper training in their hazards and the use of extreme caution at all times. 2. IT IS YOUR RESPONSIBILITY to read and understand any user's instructions, including purpose and limitations, provided with any piece of equipment you may be called on to use. 3. IT IS YOUR RESPONSIBILITY to know that you have been properly trained in Firefighting and/or Emergency Response and in the use, precautions, and care of any equipment you may be called upon to use. 4. IT IS YOUR RESPONSIBILITY to be in proper physical condition and to maintain the personal skill level required to operate any equipment you may be called upon to use. 5. IT IS YOUR RESPONSIBILITY to know that your equipment is in operable condition and has been maintained in accordance with the manufacturer's instructions. 6. Failure to follow these guidelines may result in death, burns or other severe injury. At the bottom, the FEMSA logo is shown next to the text: Fire and Emergency Manufacturers and Service Association, Inc. PO Box 147, Lynnfield, MA 01940 • www.FEMSA.org. © 2020 FEMSA. All Rights Reserved.

DANGER

PERSONAL RESPONSIBILITY CODE

The member companies of FEMSA that provide emergency response equipment and services want responders to know and understand the following:

1. **Firefighting and Emergency Response** are inherently dangerous activities requiring proper training in their hazards and the use of extreme caution at all times.
2. **IT IS YOUR RESPONSIBILITY** to read and understand any user's instructions, including purpose and limitations, provided with any piece of equipment you may be called on to use.
3. **IT IS YOUR RESPONSIBILITY** to know that you have been properly trained in Firefighting and/or Emergency Response and in the use, precautions, and care of any equipment you may be called upon to use.
4. **IT IS YOUR RESPONSIBILITY** to be in proper physical condition and to maintain the personal skill level required to operate any equipment you may be called upon to use.
5. **IT IS YOUR RESPONSIBILITY** to know that your equipment is in operable condition and has been maintained in accordance with the manufacturer's instructions.
6. Failure to follow these guidelines may result in death, burns or other severe injury.

Fire and Emergency Manufacturers and Service Association, Inc.
PO Box 147, Lynnfield, MA 01940 • www.FEMSA.org

© 2020 FEMSA. All Rights Reserved.



1.0 MEANING OF SAFETY SIGNAL WORDS

A safety related message is identified by a safety alert symbol and a signal word to indicate the level of risk involved with a particular hazard. Per ANSI Z535.6, the definitions of the four signal words are as follows:



DANGER indicates a hazardous situation which, if not avoided, will result in death or serious injury.



WARNING indicates a hazardous situation which, if not avoided, could result in death or serious injury.



CAUTION indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury.



NOTICE is used to address practices not related to physical injury.

2.0 SAFETY



Lack of foam can place operator at risk of injury or death. Establish foam flow and adequate supply of concentrate for the task before advancing into hazardous situations.



Improper use of agent could result in death or serious injury, including damage to the eyes. To reduce the risk of injury, avoid directing agent onto the faces of yourself and other personnel. Always wear PPE, including eye protection, as directed by the AHJ.



Improper use of foam or using the wrong type of foam can result in illness, injury, or damage to the environment. Follow foam manufacturer's instructions and fire service training as directed by the AHJ.

3.0 GENERAL INFORMATION

In order to produce the best quality low and medium expansion foam for firefighting, the foam solution must be aerated by some means. The FoamJet, MX-FoamJet, and FoamJet-LX series of nozzle attachments and foam nozzles provide a simple and lightweight means to aerate the foam as it exits the nozzle. The foam attachments are quickly attached or removed from the nozzle as the situation demands. The attachments are available for a variety of TFT hand held & master stream nozzles. See the following pages for a listing of available models and compatible nozzles. The label on each attachment also lists compatible nozzles.

4.0 FOAM TYPE, CONCENTRATION, AND PROPORTIONING

The FoamJet, MX-Foamjet, Foamjet-LX, and Foam Nozzle can be used with most types of concentrate including protein, fluoroprotein, AFFF, AR-AFFF (alcohol resistant foam), and SFFF (synthetic fluorine free foam).

The foam concentrate must be proportioned into the water before the nozzle by some means, such as batch mixing, eductors or direct injection systems.

The nature of the fire hazard will determine the type of foam used, the concentration, and the desired expansion ratio. Finished foam expansion and longevity (life) are largely dependent on the type and quality of foaming agents used in foam chemical formulations. Some foams will perform better than others when used with these devices.

5.0 ATTACHMENT TO THE NOZZLE

The FoamJet, MX-FoamJet, and FoamJet-LX Series are attached to the nozzle by three different methods. Each of the three methods is shown in the following pages. Each method clamps onto the bumper of the nozzle. Assure that bumper of nozzle is in good condition (no nicks or abrasions) to positively latch and seal to FoamJet attachment.

6.0 USE OF FOAM ATTACHMENTS

Refer to fire service training and foam concentrate manufacturer's recommendations for the proper use of foam.



6.1 LX FOAMJET



LX aspirators are intended to be used with the nozzle in the straight stream position only. Failure to do so will cause blow-back through the air intakes of the foam attachment.

6.2 MX FOAMJET


Foam expansion ratios from the MX Foamjet series may be adjusted by changing the bumper position of the nozzle. As the nozzle bumper is rotated back to the wide fog position, higher expansion ratios will be produced, but with reduced stream reach. Rotating the nozzle bumper into straight stream will produce lower expansion ratios, but with longer reach.

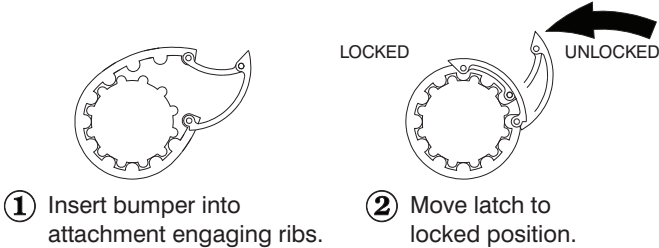


Series	FOAMJET				
Description	Low Expansion Aspiring Attachment				
Model	FJ-DQ	FJ-GD	FJ-U	FJ-HM	FJ-H
For Nozzle Series (Flow Range)	1" QuadraFog 5 - 40 GPM 5 - 60 GPM	1" G-Force 10 - 100 GPM	Ultimatic 10 - 125 GPM Metro 0 20-100 GPM	Mid-Matic Mid-Force Metro 1 70 - 200 GPM	Handline 95 - 300 GPM Dual-Force 95 - 300 GPM Metro 2 95 - 325 GPM
Attachment Method	 <p>① Insert bumper into attachment engaging ribs.</p> <p>② Move latch to locked position.</p>				
Foam Application	Use in Straight Stream Only				

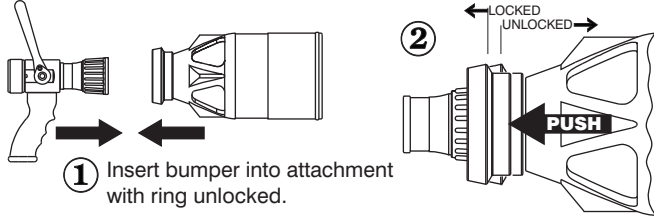
	
Series	MX FOAMJET
Description	Multi-Expansion Foam Aspiring Attachment
Model	FJ-MX-D
For Nozzle Series (Flow Range)	Twister 1" 10 - 24 GPM 10 - 40 GPM
Attachment Method	 <p>① Insert bumper into attachment with ring unlocked.</p> <p>② LOCKED UNLOCKED → ← PUSH</p>
Foam Application	Use in Straight Stream through Fog Pattern



FOG: Shorter Reach
More Expansion

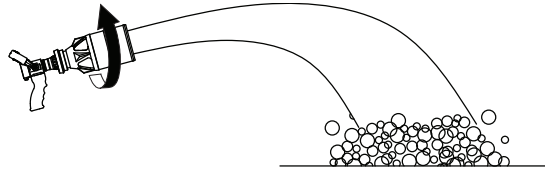


STRAIGHT STREAM:
Longer Reach, Less Expansion

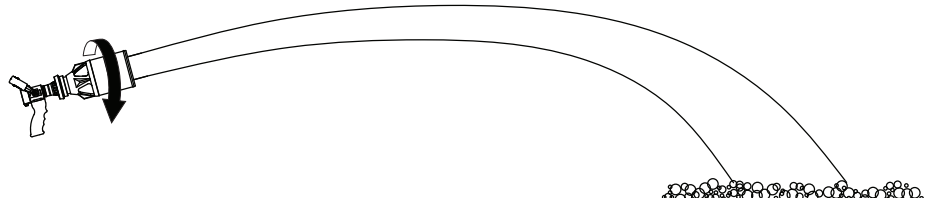












Series	MX FOAMJET							
Description	Multi-Expansion Foam Aspirating Attachment							
Model	FJ-MX-F	FJ-MX-DQ	FJ-UMX	FJ-MX-FQ	FJ-MX-FT	FJ-MX-HM	FJ-MX-G	FJ-HMX
For Nozzle Series (Flow Range)	1.5" Twister 20-60 GPM 20-95 GPM	1" Quadrafog 5-40 GPM 5-60 GPM Medium Expansion Suitable for 24,40&60 GPM Settings ONLY	Ultimatic 10-125 GPM Metro 0 20-100 GPM FJ-UMX-G 1" G-Force 10-100 GPM	1.5" Quadrafog 30-125 GPM	Thunderfog Series 30-200 GPM 95-250 GPM QuadraFog 1000 110-1000 l/min	Mid-Matic Mid-Force Metro 1 70-200 GPM	1.5" G-Force 30-150 GPM	Handline 95-300 GPM Dual-Force 95-300 GPM Metro 2 95-325 GPM
Attachment Method	<div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;">  <p>① Insert bumper with latch unlocked.</p> </div> <div style="text-align: center;"> <p>UNLOCKED LOCKED</p>  <p>② Push levers down to lock in place.</p> </div> </div>							
Foam Application	<p>Use in Straight Stream through Fog Pattern</p>							


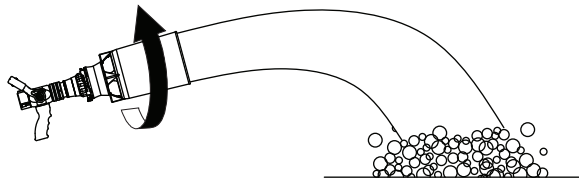
FOG: Shorter Reach
More Expansion

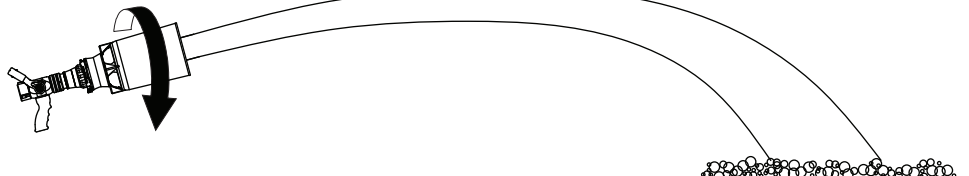


STRAIGHT STREAM:
Longer Reach, Less Expansion

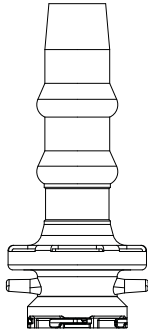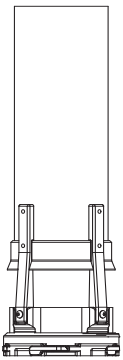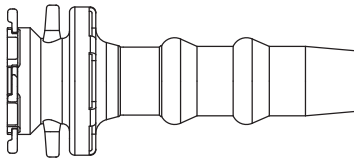


						
Series	FOAMJET-LX					
Description	Low Expansion Foam Aspiring Attachment					
Model	FJ-LX-U	FJ-LX-G	FJ-LX-FQ	FJ-LX-HM	FJ-LX-M	FJ-LX-M2
For Nozzle Series (Flow Range)	Ultimatic 10-125 GPM Metro 0 20-100 GPM	1.5" G-Force 30-150 GPM	1.5" Quadrafog 30-125 GPM	Mid-Matic Mid-Force Metro 1 70-200 GPM	Master Stream 1000, 1250S Master Foam 250-750 GPM (946-2839 l/min) and Master Force 300-800 GPM (1100-3000 l/min) series nozzles	M-F* series Master Stream nozzles
	FJ-LX-U-G 1" G-Force 10-100 GPM					FJ-LX-M3 Master Stream 1250, 1500
Attachment Method	    <p>① Insert bumper into attachment with latches unlocked ② Align latches between bumper and ribs ③ Lock all latches</p>					
Foam Application	<p>Use in Straight Stream Only</p> 					


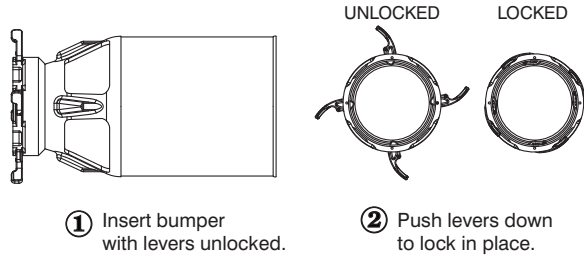
	
Series	MX FOAMJET
Description	Low Expansion Foam Aspirating Attachment
Model	FJ-MX-MD
For Nozzle Series (Flow Range)	MD Series: 100-500 GPM (Max-Force, Max-Matic, Max-Flow) ZN Series: 350, 500 & 750 GPM Industrial Nozzle
Attachment Method	 <p>① Insert bumper with levers unlocked.</p> <p>② Push levers down to lock in place.</p>
Foam Application	Use in Straight Stream through Fog Pattern

FOG: Shorter Reach
More Expansion

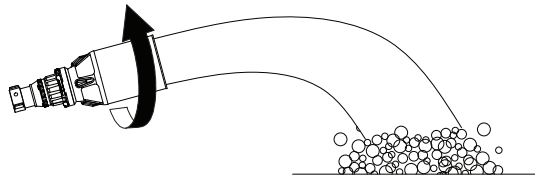

STRAIGHT STREAM:
Longer Reach, Less Expansion

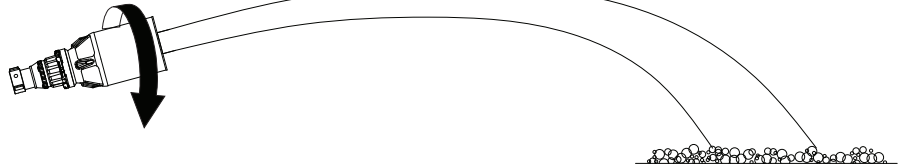

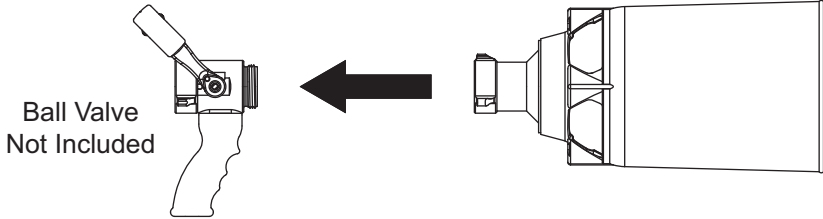			
Series	MX FOAMJET NOZZLE		
Description	Medium Expansion Foam Nozzle		
Model	FJ-MX-060	FJ-MX-095	FJ-MX-125
For Nozzle Series (Flow Range)	60 GPM @ 60 PSI 225 l/min @ 4 bar	95 GPM @ 60 PSI 360 l/min @ 4 bar	125 GPM @ 60 PSI 475 l/min @ 4 bar
Attachment Method			
Foam Application	Full Open Valve Straight Hose Line		

7.0 USING FOAM

It is recommended that the Class A foam used meets USDA Forest Service 5100-307A "Specification for Fire Suppressant Foam for Wildland Firefighting (Class A Foam)", or NFPA 1150 "Foam Chemicals for Fires in Class A Fuels".

⚠ WARNING

Improper use of foam or using the wrong type of foam can result in illness, injury, or damage to the environment. Follow foam manufacturer's instructions and fire service training as directed by the AHJ.

⚠ WARNING

For Class B fires, lack of foam or interruption in the foam stream can cause a break in the foam blanket and greatly increase the risk of injury or death. Follow procedures established by the AHJ for the specific fuel and conditions.

8.0 WARRANTY

Task Force Tips LLC, 3701 Innovation Way, Valparaiso, Indiana 46383-9327 USA ("TFT") warrants to the original purchaser of its products ("equipment"), and to anyone to whom it is transferred, that the equipment shall be free from defects in material and workmanship during the five (5) year period from the date of purchase for mechanical components, and the two (2) year period from the date of purchase for electrical components. TFT's obligation under this warranty is specifically limited to replacing or repairing the equipment (or its parts) which are shown by TFT's examination to be in a defective condition attributable to TFT. To qualify for this limited warranty, the claimant must return the equipment to TFT, at 3701 Innovation Way, Valparaiso, Indiana 46383-9327 USA, within a reasonable time after discovery of the defect. TFT will examine the equipment. If TFT determines that there is a defect attributable to it, TFT will correct the problem within a reasonable time. If the equipment is covered by this limited warranty, TFT will assume the expenses of repair.

If any defect attributable to TFT under this limited warranty cannot be reasonably cured by repair or replacement, TFT may elect to refund the purchase price of the equipment, less reasonable depreciation, in complete discharge of its obligations under this limited warranty. If TFT makes this election, claimant shall return the equipment to TFT free and clear of any liens and encumbrances.

This is a limited warranty. The original purchaser of the equipment, any person to whom it is transferred, and any person who is an intended or unintended beneficiary of the equipment, shall not be entitled to recover from TFT any consequential or incidental damages for injury to person and/or property resulting from any defective equipment manufactured or assembled by TFT.

It is agreed and understood that the price stated for the equipment is in part consideration for limiting TFT's liability. Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above may not apply to you.

TFT shall have no obligation under this limited warranty if the equipment is, or has been, misused or neglected (including failure to provide reasonable maintenance) or if there have been accidents to the equipment or if it has been repaired or altered by someone else.

THIS IS A LIMITED EXPRESS WARRANTY ONLY. TFT EXPRESSLY DISCLAIMS WITH RESPECT TO THE EQUIPMENT ALL IMPLIED WARRANTIES OF MERCHANTABILITY AND ALL IMPLIED WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE. THERE IS NO WARRANTY OF ANY NATURE MADE BY TFT BEYOND THAT STATED IN THIS DOCUMENT.

This limited warranty gives you specific legal rights, and you may also have other rights which vary from state to state.

9.0 MAINTENANCE

TFT products are designed and manufactured to be damage resistant and require minimal maintenance. However, as the primary firefighting tool upon which your life depends, it should be treated accordingly. To help prevent mechanical damage, do not drop or throw equipment.

9.1 FIELD LUBRICATION

All Task Force Tips nozzles are factory lubricated with high quality silicone grease. This lubricant has excellent wash out resistance, providing long term performance. If your agency has unusually hard or sandy water, the moving parts of the nozzle may be affected. Foam agents and water additives contain soaps and chemicals that may break down the factory lubrication.

The moving parts of the nozzle should be checked on a regular basis for smooth and free operation, and for signs of damage. IF THE NOZZLE IS OPERATING CORRECTLY, THEN NO ADDITIONAL LUBRICANT IS NEEDED. Any nozzle that is not operating correctly should be immediately removed from service. The nozzle can be returned to the factory at any time for a complete checkup and re-lubrication with silicone grease.

The field use of Break Free CLP (spray or liquid) lubricant will help to temporarily restore the smooth and free operation of the nozzle. These lubricants do not have the washout resistance and long-term performance of the silicone grease. Once Break Free CLP is applied, re-application will be needed on a regular basis until the nozzle can be returned to the factory for a complete checkup and re-lubrication with silicone grease.



Aerosol lubricants contain solvents that can swell O-Rings if applied in excess. The swelling can inhibit smooth operation of the moving parts. When used in moderation, as directed, the solvents quickly evaporate without adversely swelling the O-Rings.

9.2 SERVICE TESTING

In accordance with NFPA 1962, equipment must be tested a minimum of annually. Units failing any part of this test must be removed from service, repaired and retested upon completion of the repair.

9.3 REPAIR

Factory service is available. Factory serviced equipment is repaired by experienced technicians, wet tested to original specifications, and promptly returned. Call TFT service department at 1-800-348-2686 to troubleshoot and, if needed, directions for return. A return for service form can also be obtained at tft.com/Support/Returning-an-Item-for-Service.

Repair parts and service procedures are available for those wishing to perform their own repairs. Task Force Tips assumes no liability for damage to equipment or injury to personnel that is a result of user service. Contact the factory or visit the web site at tft.com for parts lists, exploded views, test procedures and troubleshooting guides.

Performance tests shall be conducted on the equipment after a repair, or anytime a problem is reported to verify operation in accordance with TFT test procedures. Consult factory for the procedure that corresponds to the model and serial number of the equipment. Any equipment which fails the related test criteria should be removed from service immediately. Troubleshooting guides are available with each test procedure or equipment can be returned to the factory for service and testing.



It is the responsibility of service technicians to ensure the use of appropriate protective clothing and equipment. The chosen protective clothing and equipment must provide protection from potential hazards users may encounter while servicing equipment. Requirements for protective clothing and equipment are determined by the Authority Having Jurisdiction (AHJ).



Any alterations to the product or its markings could diminish safety and constitutes a misuse of this product.



All replacement parts must be obtained from the manufacturer to assure proper performance and operation of the device.

10.0 OPERATION AND INSPECTION CHECKLIST

BEFORE EACH USE, appliances must be inspected to this checklist:

- There is no obvious damage such as missing, broken or loose parts, dents cracks, corrosion, or other defects that could impair safe operation.
- Clamps and mounted objects are secure.
- Hose and nozzle are securely attached.
- All swiveling elements rotate freely.
- Foamjet is pointed in a safe direction.

BEFORE BEING PLACED BACK IN SERVICE, appliances must be inspected to this list:

- The waterway is clear of obstructions.
- There is no damage to any connections.
- All locks and hold-down devices work properly.
- There is no obvious damage such as missing, broken or loose parts, dents cracks, corrosion, or other defects that could impair safe operation.
- All swiveling elements rotate freely.
- There are no missing parts or components.



Equipment failing any part of the checklist is unsafe for use and must have the problem corrected before use or being placed back into service. Operating equipment that has failed the checklist is a misuse of this equipment.